



# IMPROVEMENT PERMIT

Montgomery County Health Department - Env  
444 N. Main Street  
Troy, NC 27371  
Phone: (910) 572-8175

### For Office Use Only

\*CDP File Number: 458550 - 1  
County ID Number: 7650 00 07 5559  
Evaluated For: NEW

PERMIT VALID UNTIL: 09/08/2030

**\*NOTE TO INSPECTIONS DIVISION:** Building Permits cannot be issued with this Improvement Permit.

Applicant: JOSEPH ALAN BARNEY  
 Address: 25185 FRICK RD  
 City: RICHFIELD  
 State/Zip: NC 28127  
 Phone #: home: (434) 710-0101

Property Owner: JOSEPH ALAN BARNEY  
 Address: 25185 FRICK RD  
 City: RICHFIELD  
 State/Zip: NC. 28127  
 Phone #: home: (434) 710-0101

### Property Location & Site Information

Address: OKEEWEMEE RD Troy, NC 27371 Subdivision: \_\_\_\_\_ Block/Phase: NEW Lot: \_\_\_\_\_  
 Road #: \_\_\_\_\_  
 Structure: SINGLE FAMILY **Directions** 1852 OKEEWEMEE RD, Troy NC 27371  
 # of Bedrooms: 3  
 # of People: 6  
 \*Water Supply: N/A

### System Specifications

**Initial System**  
 Usable Soil Depth: 42 Minimum Trench Depth: 24 Inches  
 Design Flow: 360 Maximum Trench Depth: 30 Inches  
 Soil Application Rate: 0.3000  
 \*System Classification/Description: \_\_\_\_\_ Septic Tank: 1000 Gallons  
 TYPE II A. CONV SYSTEM (SINGLE-FAMILY OR 480 GPD OR LESS) Pump Required  Yes  No  May Be Required  
 \*Proposed System: CONVENTIONAL Pump Tank: \_\_\_\_\_ Gallons

Repair System Required:  Yes  No  No, but has Available Space

### Repair System

Usable Soil Depth: 42 Minimum Trench Depth: 24 Inches  
 Soil Application Rate: 0.300 Maximum Trench: Depth: 30 Inches  
 \*System Classification/Description: \_\_\_\_\_ Pump Required:  Yes  No  May Be Required  
 TYPE II A. CONV SYSTEM (SINGLE-FAMILY OR 480 GPD OR LESS)  
 \*Proposed System: CONVENTIONAL Pump Tank: \_\_\_\_\_ Gallons

No grading or construction activity is allowed in areas designated for system and repair without approval of Health Department.

### \*Site Modifications


The issuance of this permit by the Health Department in no way guarantees the issuance of other permits. The permit holder is responsible for checking with appropriate governing bodies in meeting their requirements.

### \*Permit Conditions

Permit issued for 3-BR SFR (360 gpd)  
 Initial and Repair: Conventional  
 Length: 400'; Depth: 24-30"; Width: 36"; Stone: 12"; 9' center spacing  
 Property line adjacent to system area to be flagged prior to installation.

The Department and Local Health Department may impose conditions on the issuance and may revoke the permits for failure of the system to satisfy the conditions, the rules, or this article. This permit is subject to revocation if the site plan, plat, or intended use changes (NCGS 130A-335(f)). The person owning or controlling the system location, installing, operation, maintenance, monitoring, reporting, and repair (per rule .0301(a)).

Authorized State Agent:



Cole, Scott

Date of Issue:

09/08/2025

Total Time: (HH:MM)




Hand Drawing



Import Drawing

**\*\*Site Plan/Drawing attached.\*\***

\_\_\_\_\_ : \_\_\_\_\_

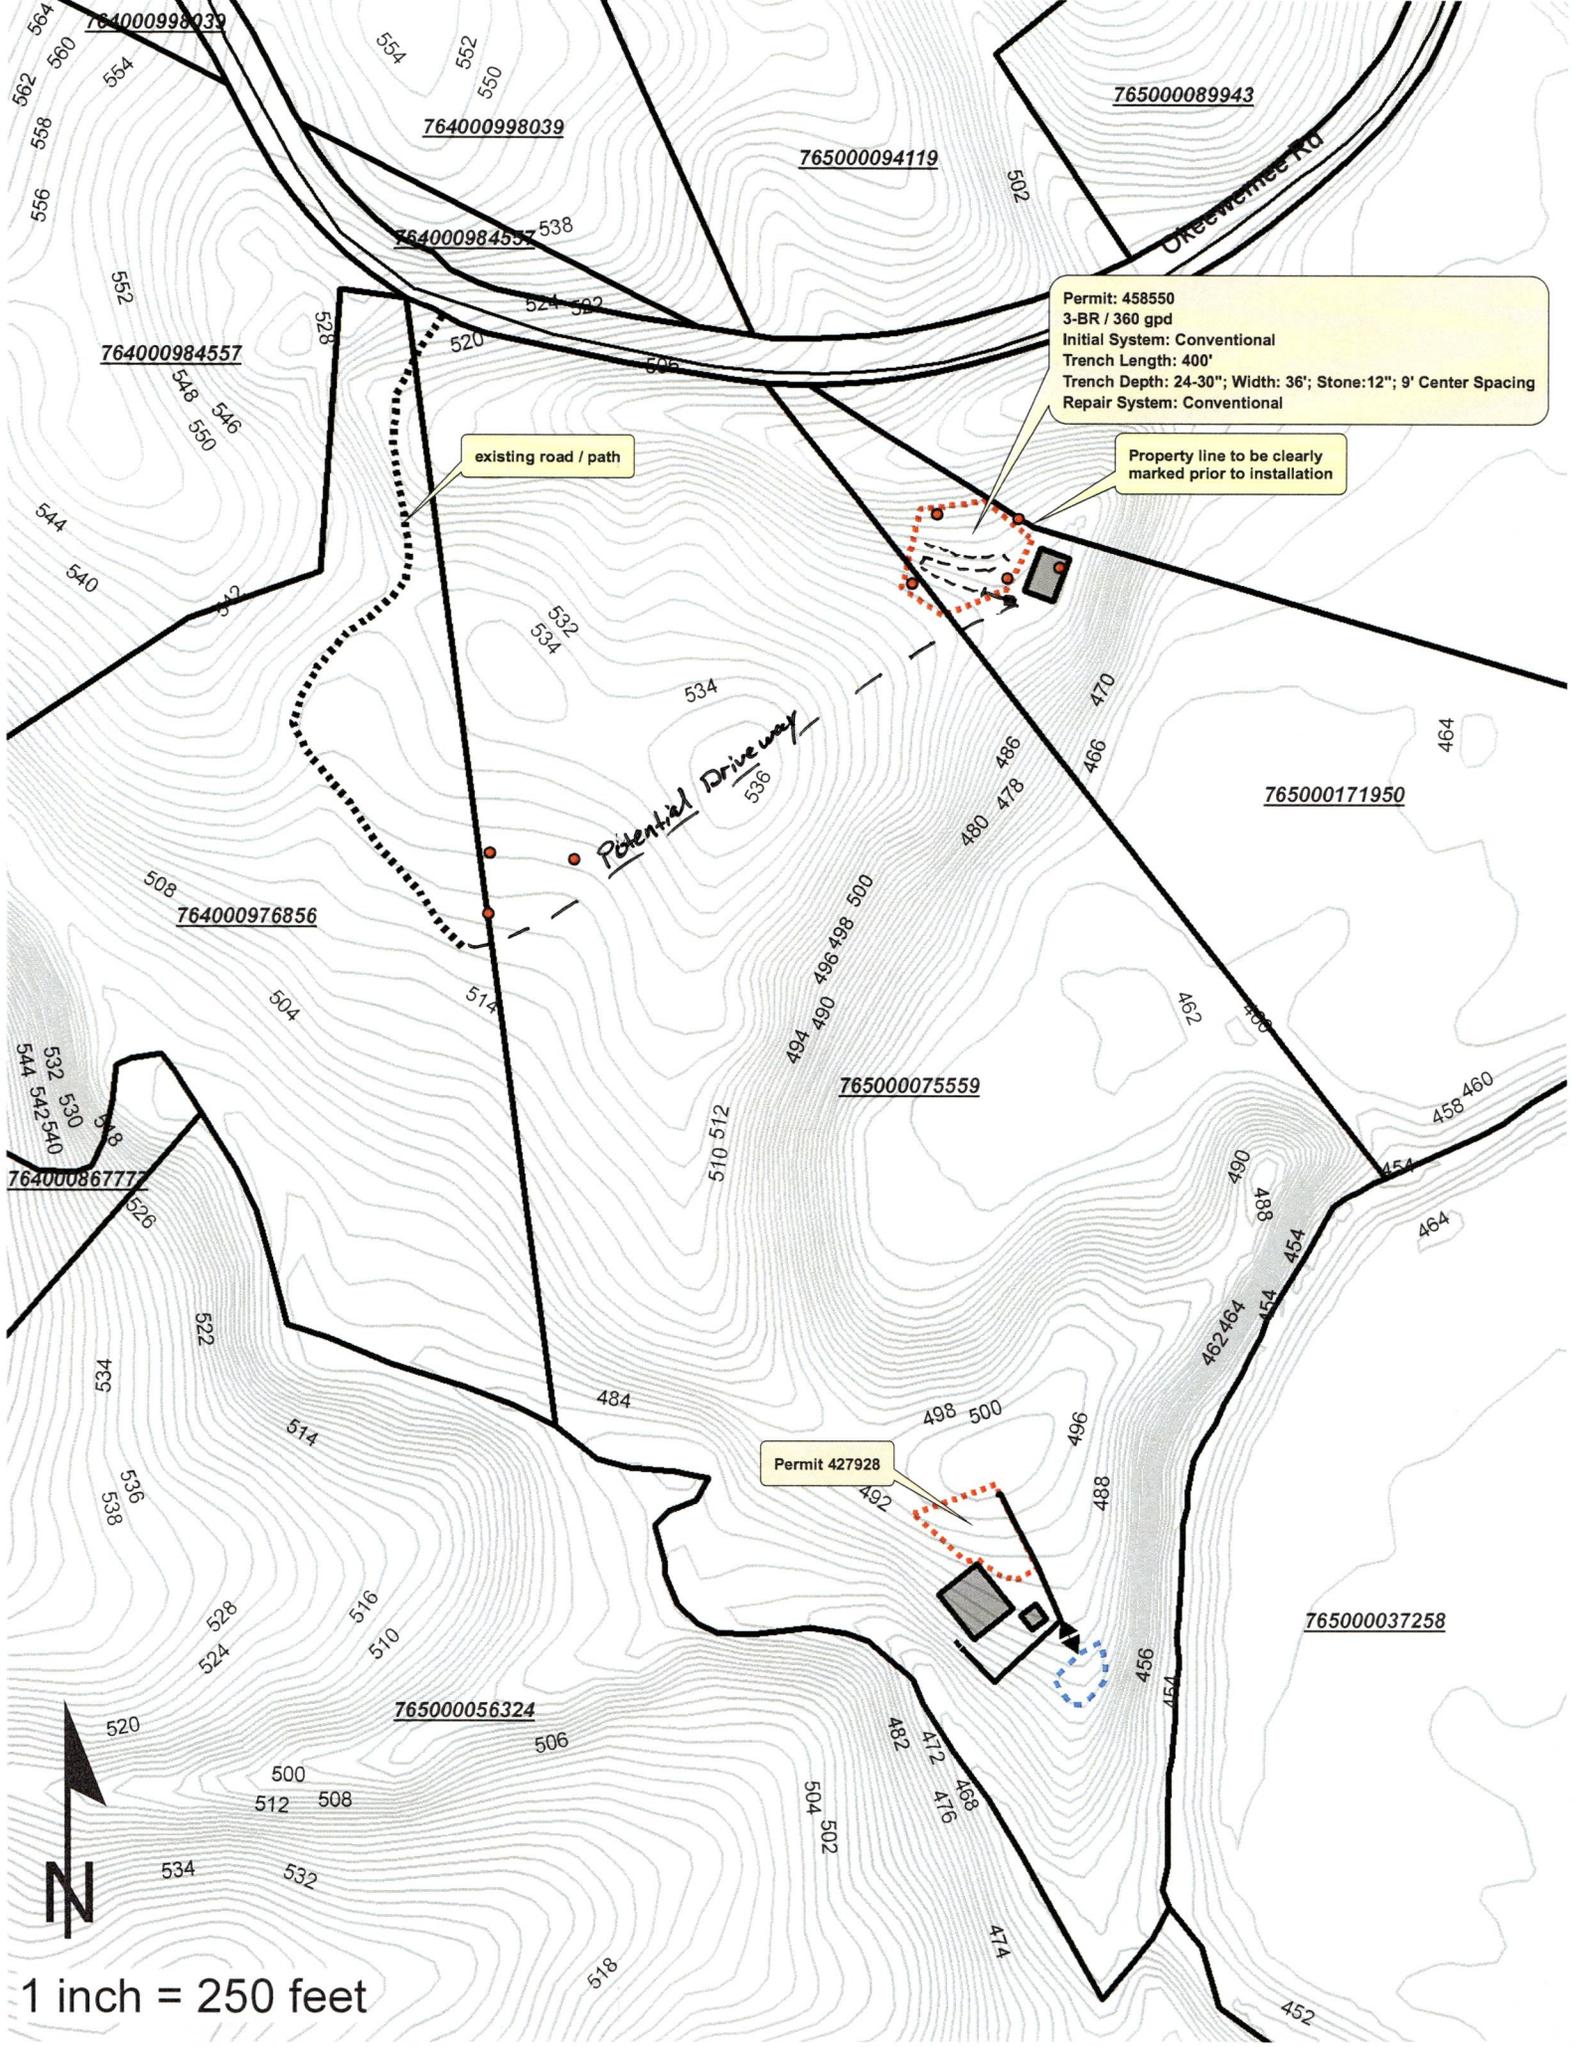

Permit: 458550  
3-BR / 360 gpd  
Initial System: Conventional  
Trench Length: 400'  
Trench Depth: 24-30"; Width: 36"; Stone: 12"; 9' Center Spacing  
Repair System: Conventional


Property line to be clearly marked prior to installation

existing road / path

Permit 427928

1 inch = 250 feet



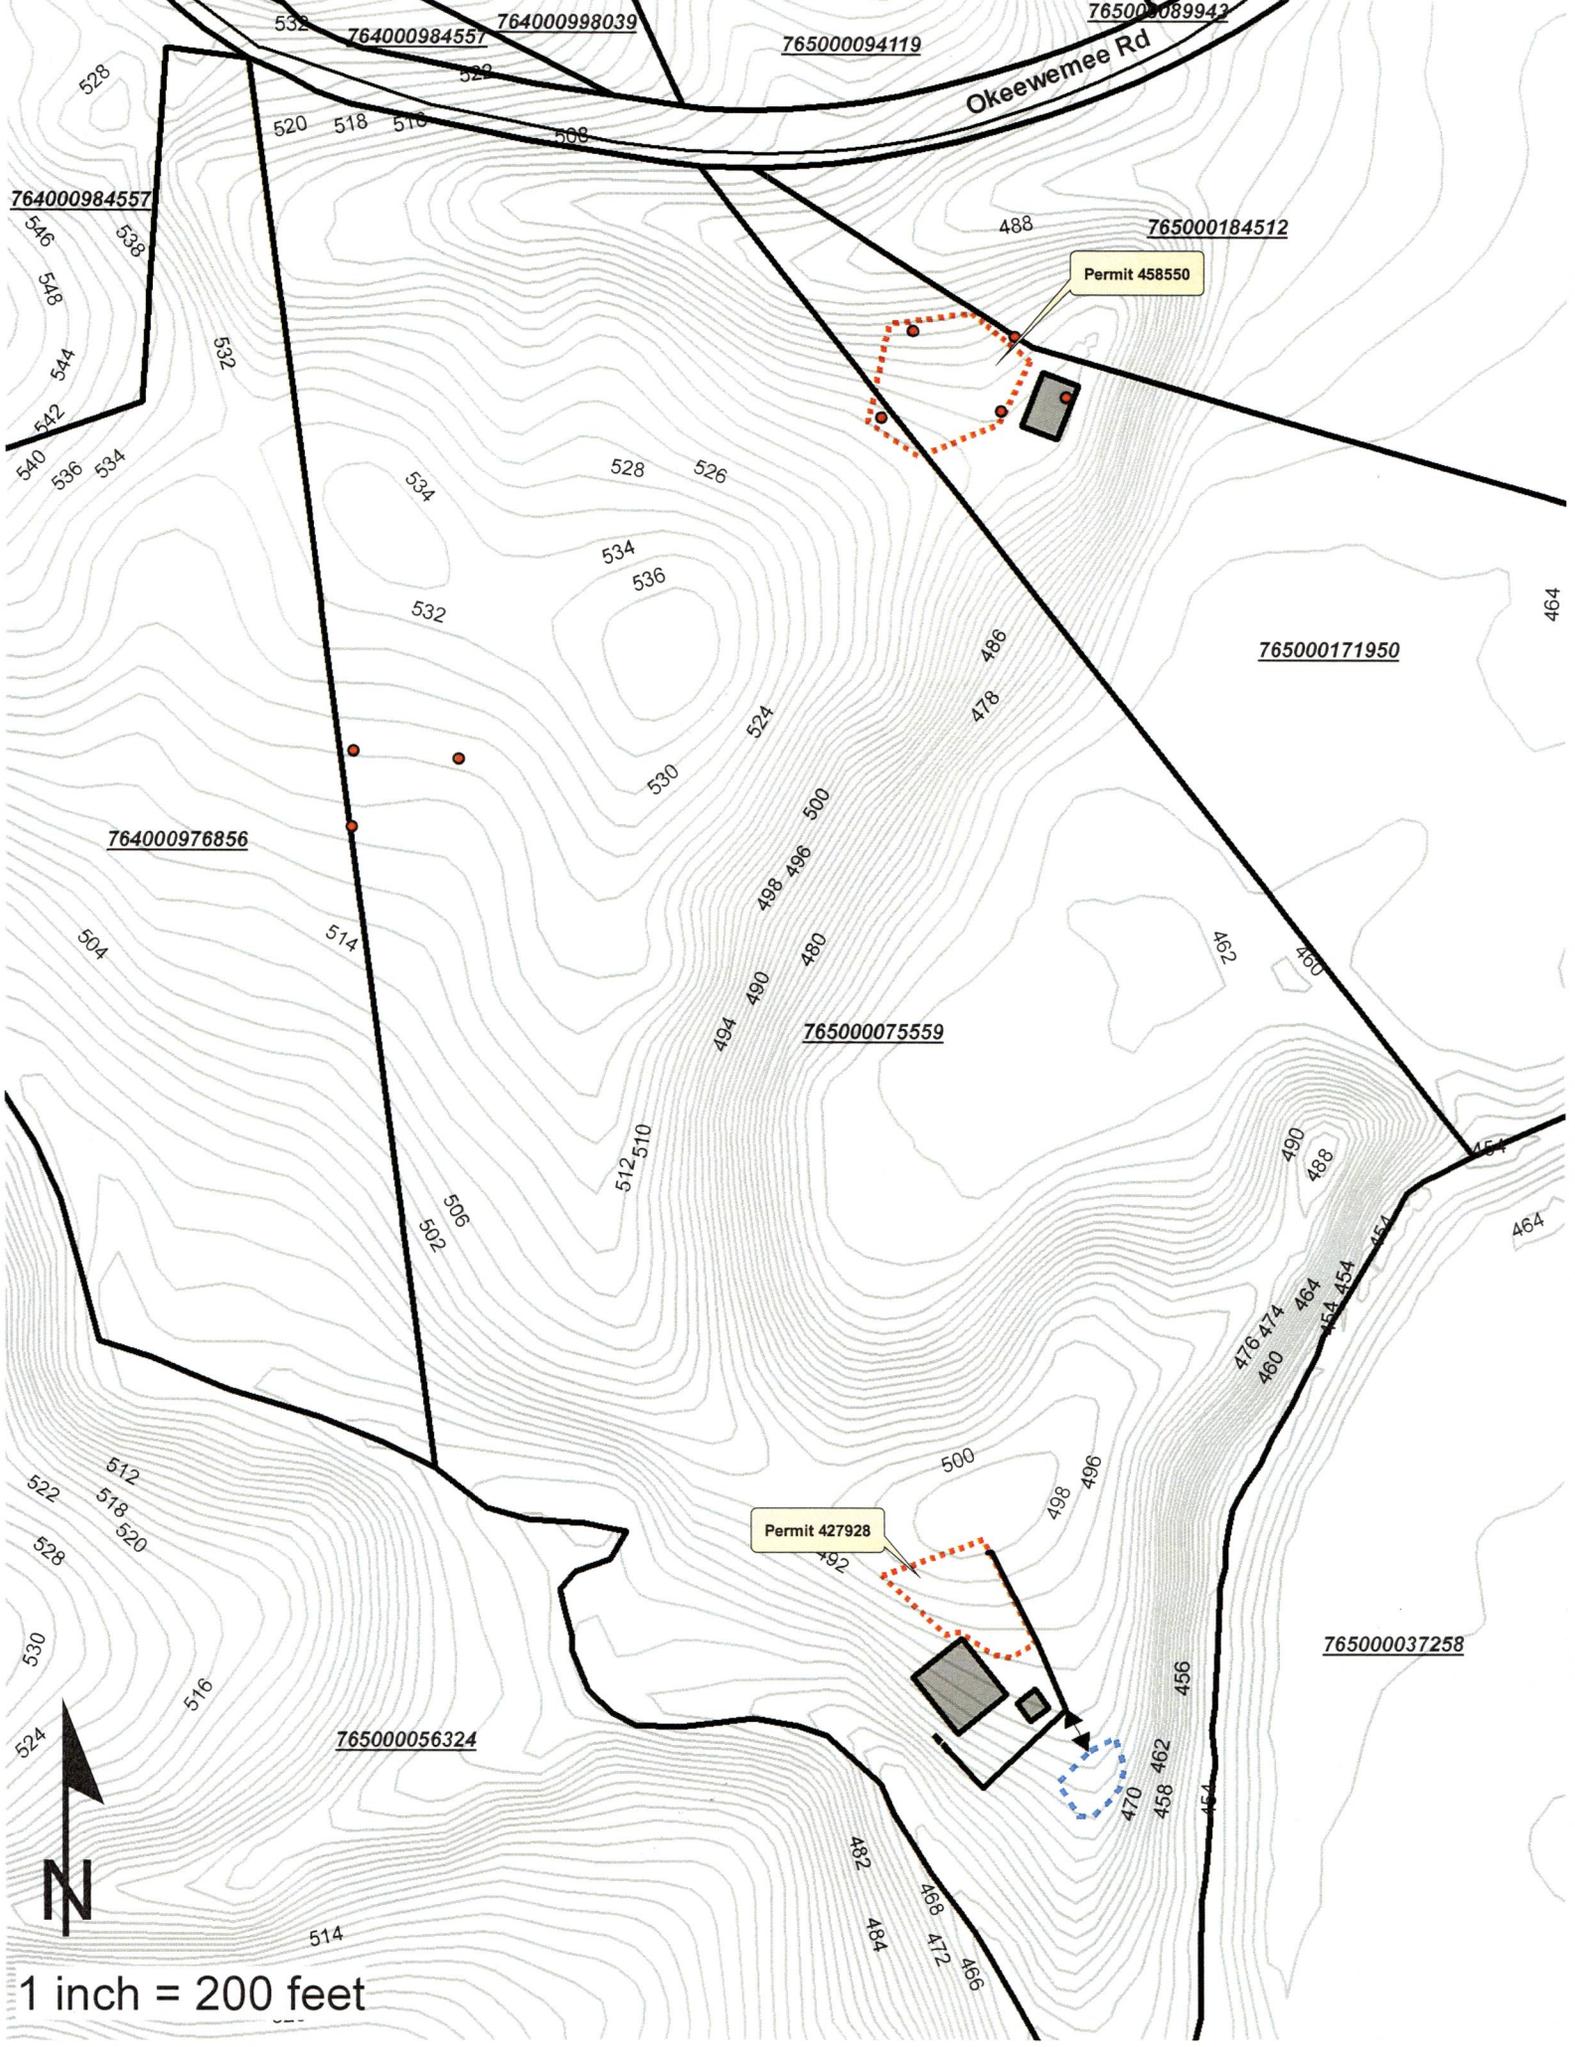

1 inch = 200 feet



Permit 458550

Permit 427928

765000037258

765000171950

765000184512

765000075559

764000976856

764000984557

765000056324

764000984557

764000998039

765000094119

765000089942